AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

TEST REPORT

Client: HTT Flooring

 HTT Flooring
 Test Number
 :
 23-003220

 16/42-44 Birnie Avenue
 Issue Date
 :
 22/09/2023

 Lidcombe NSW 2141
 Print Date
 :
 28/09/2023


Sample Description Clients Ref : "Duro-Hybrid"

Hybrid flooring planks with 1XPE backing

End Use: Flooring

Nominal Composition : Plastic and Limestone
Nominal Mass per Unit Area/Density : 10072g/m2

Nominal Thickness: 7mm

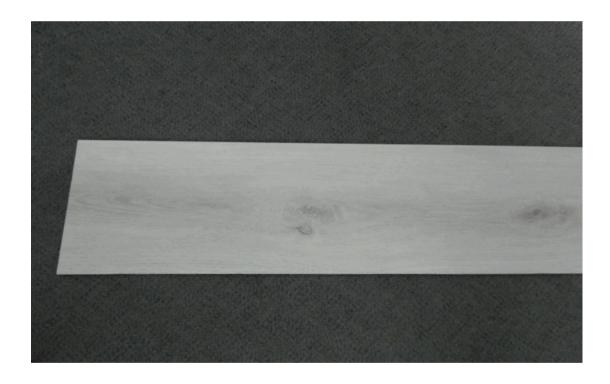

305785 66145 Page 1 of 2

Australian Wool Testing Authority Ltd Copyright - All Rights Reserved



Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



OHAFL A. JACKSON B.Sc.(Hons)

Chris Campbell

APPROVED SIGNATORY

AWTA PRODUCT TESTING

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106

1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

TEST REPORT

Client: HTT Flooring

16/42-44 Birnie Avenue Lidcombe NSW 2141 Test Number : 23-003220 Issue Date : 22/09/2023

Print Date

10-08-2023

: 28/09/2023

AS ISO 9239.1-2003

Reaction to Fire Tests for Floorings. Determination of the Burning Behaviour using a Radiant Heat Source

Date of Sample Arrival

Date Tested 21-09-2023

CHF Value 1 2 3 Mean 10.5 10.3 10.4 10.3 kW/m² Length Width 10.8 kW/m² Smoke Value 2 3 1 Mean 83 96 90 90 %.min Length 93 %.min Width

Observation

Blistering Yes

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

Sample was conditioned in accordance with BSEN 13238:2010 at a temperature of 23±2°C and relative humidity of 50±5% for a minimum of 48 hours prior to testing.

Results in accordance with section 8.4 have not been included in the report. They are available upon request.

Each specimen was adhered to a substrate of 6mm thick fibre reinforced cement board using Roberts 656 adhesive and clamped prior to testing.

HF30 not reported as flame out time occurred before 30 minutes.

305785 66145 Page 2 of 2

Australian Wool Testing Authority Ltd Copyright - All Rights Reserved

0204/11/06



Accredited for compliance with ISO/IEC 17025 - Testing Accreditation Numbers: 983, 985, and 1356

Samples and their identifying descriptions have been provided by the client unless otherwise stated. AWTA Ltd makes no warranty, implied or otherwise, as to the source of the tested samples. The above test results relate only to the sample or samples tested. This document shall not be reproduced except in full and shall be rendered void if amended or altered. This document, the names AWTA Product Testing and AWTA Ltd may be used in advertising providing the content and format of the advertisement have been approved by the Managing Director of AWTA Ltd.



MICHAEL A. JACKSON B.Sc.(Hons)

Chris Campbell

APPROVED SIGNATORY